

(MAX.) TRENCH WIDTHS—9" + O.D. + 9", WHEN TRENCH IS LESS THAN 5 FT. DEEP
 -18" + O.D. + 18", WHEN TRENCH IS GREATER THAN 5 FT. DEEP

FINISHED GRADE — SEE PLANS AND SPECIFICATIONS FOR SURFACE RESTORATION

OUTSIDE OF SHEETING OR BOX, WHEN NECESSARY OR REQUIRED

4"


FA-6, FA-1, FA-2, OR CA-6 (GRADE) 8 OR 9) TRENCH BACKFILL JETTED OR COMPACTED IN NORMAL 8" LIFTS FOR 36" EACH SIDE OF OR UNDER PAVEMENT, CURB, OR GUTTER, DRIVEWAYS AND SIDEWALKS OR WHEN DIRECTED BY ENGINEER.

VOIDS SHALL BE FILLED WITH WELL GRADED GRANULAR MATERIAL AT TIME OF REMOVAL OF TRENCH SHEETING AND BRACING

CA-6 CRUSHED MATERIAL

SEE PIPE BEDDING DETAIL

UNDER CUT WHERE DIRECTED REMOVE UNSUITABLE MATERIAL REPALCE WITH CA-6 (CRUSHED)

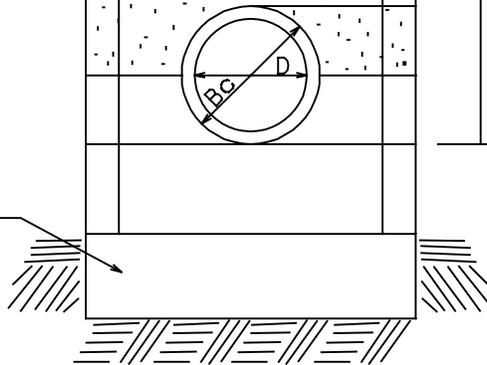

NOTE: ALL SANITARY SEWER SHALL HAVE MIN. OF 6" CA-6 BEDDING BELOW PIPE & 12" ABOVE PIPE. Bc = OUTER DIAMETER OF PIPE D = NOMINAL DIAMETER OF PIPE

SCALE = N.T.S.

MAINE TOWNSHIP HIGHWAY DEPARTMENT

TYPICAL TRENCH AND BEDDING DETAIL



REVISIONS

REVISIONS	